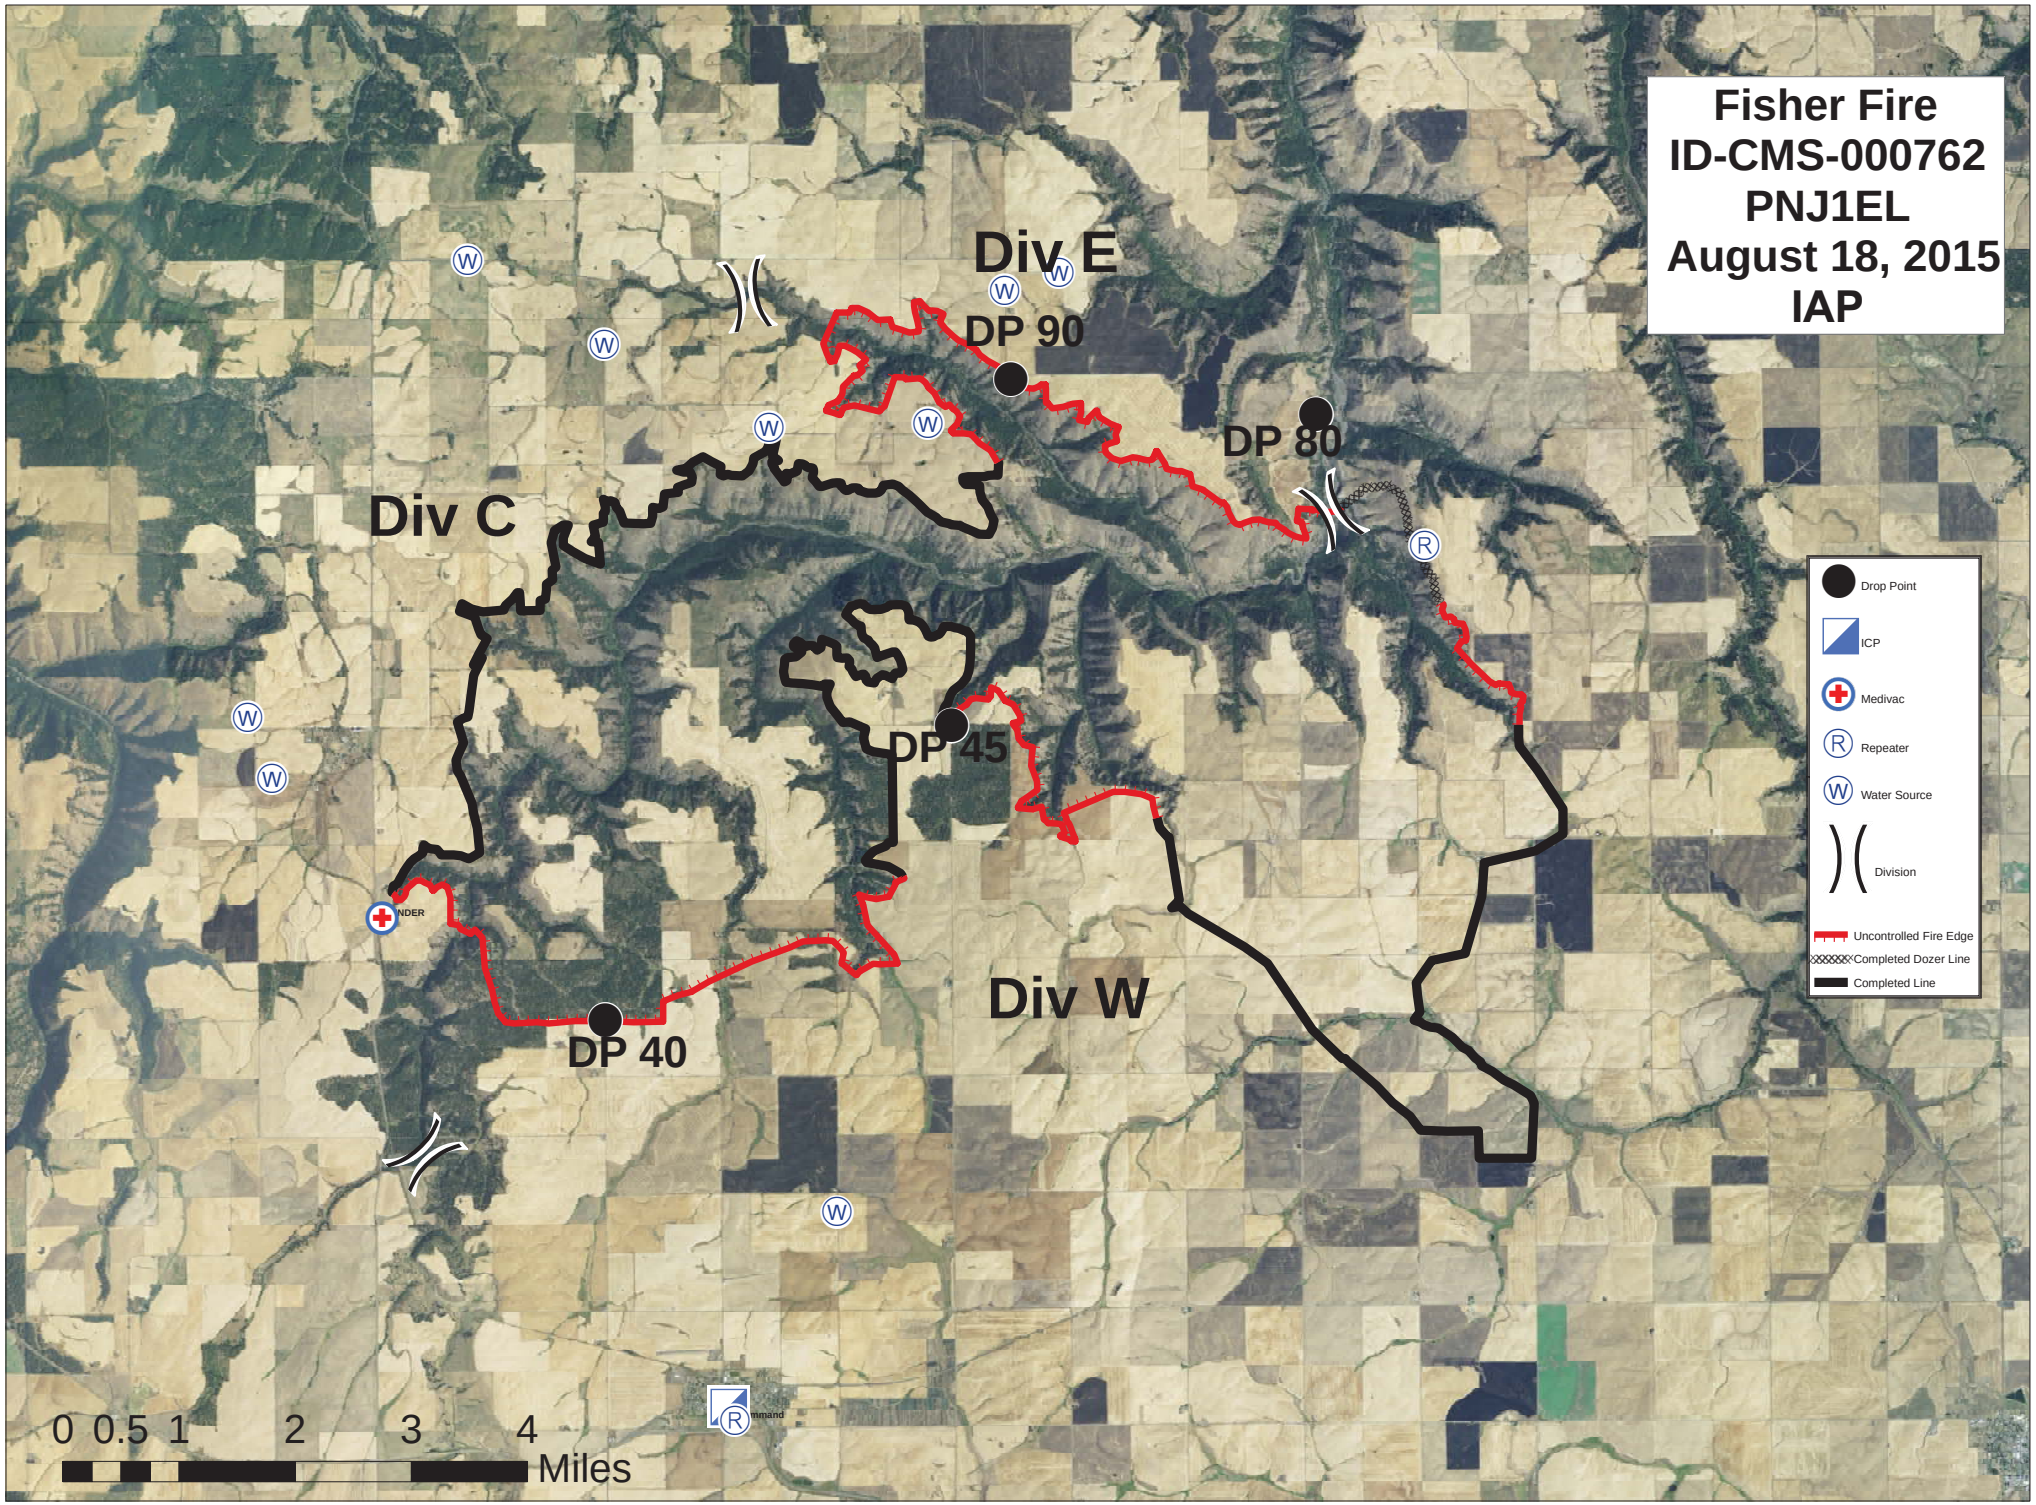
Fisher Fire
ID-CMS-000762
PNJ1EL
August 18, 2015
IAP
Div E
DP 90
DP 80
Div C
DP 45
Div W
DP 40
Drop Point
ICP
Medivac
Repeater
Water Source
Division
Uncontrolled Fire Edge
Completed Dozer Line
Completed Line
0 0.5 1 2 3 4
Miles