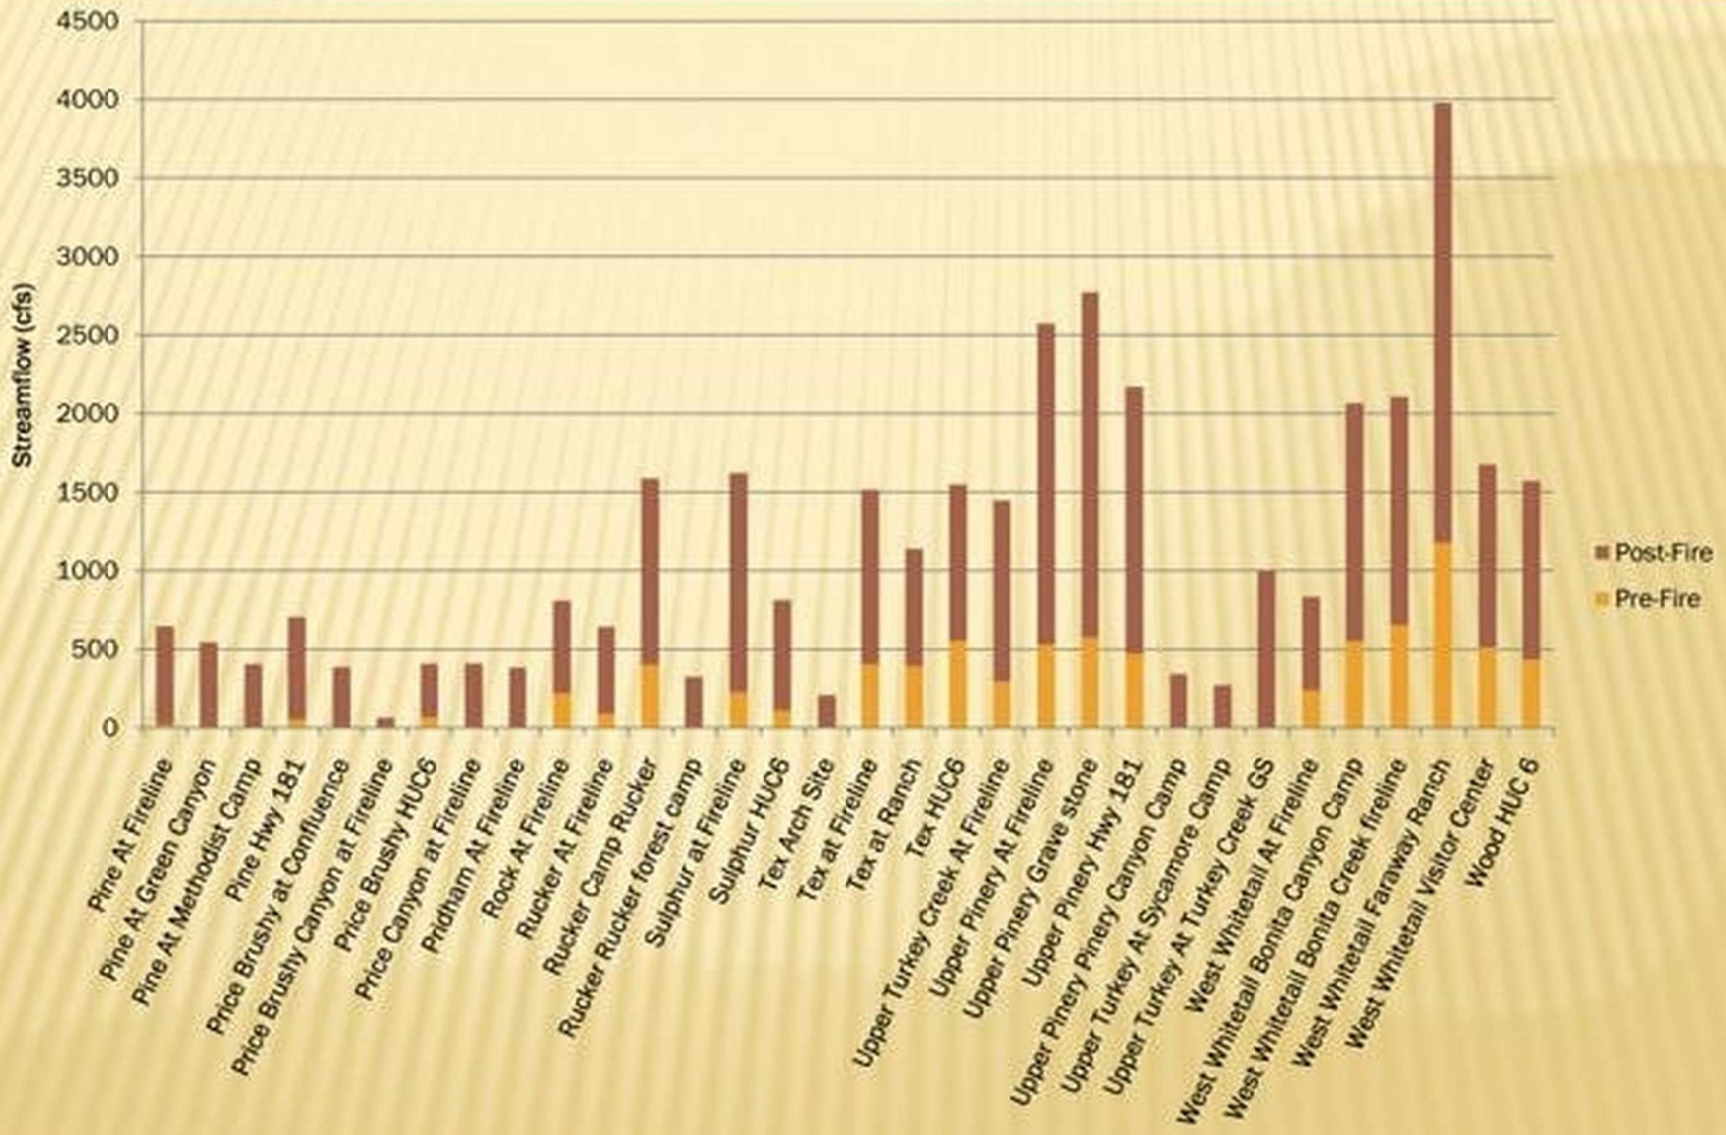Pre and Post Fire Discharge Calculations